



Slim Air

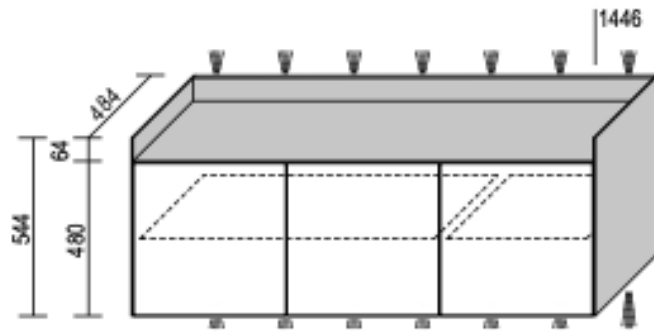


ing system must be connected to a switch of the power grid of the room.


1934

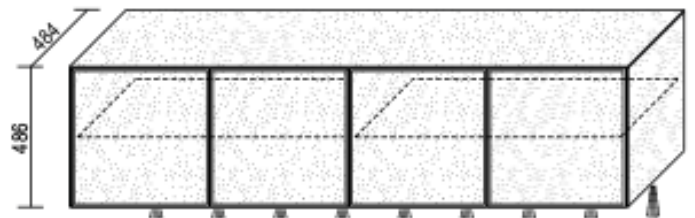

ing system must be connected to a switch of the power grid of the room.

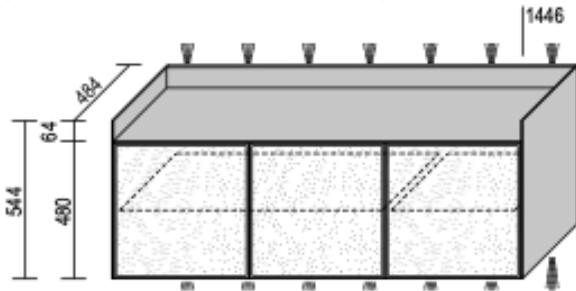


1932

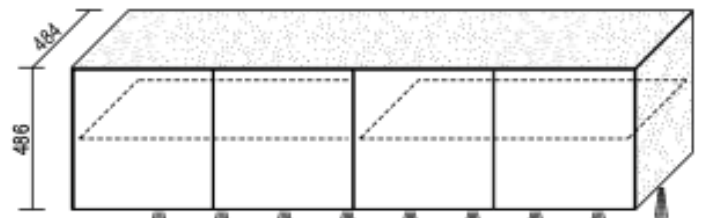


ected to a switch of the power grid of the room.

1454

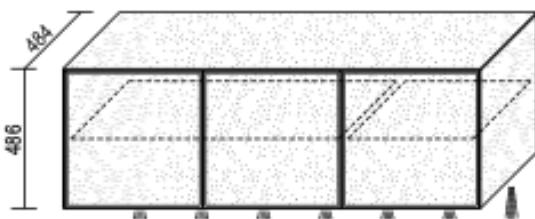


ing system must be connected to a switch of the power grid of the room.

1926

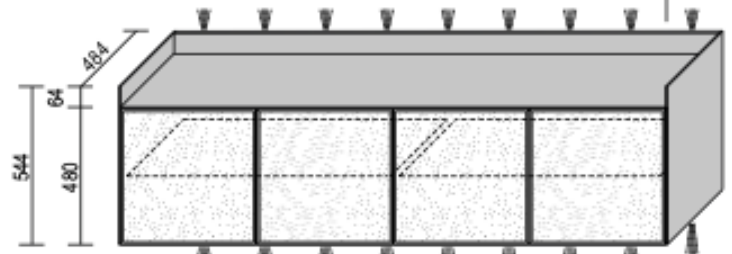

1452

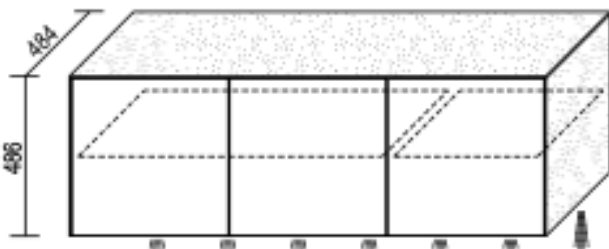

1926

